

Test Report No. 7191168129-MEC17-ED
dated 5 Oct 2017



PSB Singapore

**Choose certainty.
Add value.**

Note: This report is issued subject to the Testing and Certification Regulations of the TÜV SÜD Group and the General Terms and Conditions of Business of TÜV SÜD PSB Pte Ltd. In addition, this report is governed by the terms set out within this report.

SUBJECT:

Testing of sealant

TESTED FOR:

PFE Technologies Pte Ltd
No. 9 Gul Street 4
Singapore 629238

Attn: Mr Hans Goh

SAMPLE DESCRIPTION:

The following items were received on 28 Jul 2017 as shown:

Sample	Size	Quantity
'Pereseal Polyurethane Sealant' (Photo 1)	600 ml/sausage	10 sausages

TEST METHODS:

HDB Specification : Sealant - Semi-Precast Construction

Staining And Colour Change

1. Adopted ASTM C510 : 2016 Standard Test Method For Staining And Colour Change Of Single Or Multi-Component Joint Sealants

Test cycle : 8 hours UV exposure at 55°C and 4 hours condensation at 45°C
Exposure duration : 100 hours
No. of determination : 1 for staining test, 1 for colour change test, 1 as control

Extrudability

2. Adopted ASTM C1183/C1183M : 2013 Standard Test Method For Extrusion Rate Of Elastomeric Sealants

Test pressure : 40 psi
No. of determination : 1



Laboratory:
TUV SUD PSB Pte. Ltd.
No. 1 Science Park Drive
Singapore 118221

Phone : +65-6885 1333
Fax : +65-6776 8670
E-mail: enquiries@tuv-sud-psb.sg
www.tuv-sud-psb.sg
Co. Reg : 199002667R

Regional Head Office:
TUV SUD Asia Pacific Pte. Ltd.
1 Science Park Drive, #02-01
Singapore 118221
TUV®

Test Report No. 7191168129-MEC17-ED
dated 5 Oct 2017



PSB Singapore

Flow Properties

3. ASTM C639 : 2015 Standard Test Method For Rheological (Flow) Properties Of Elastomeric Sealants

Method : Test method for 'Type II' sealant
Test conditions : a) 4.4°C in environmental chamber for 4 hours
b) 50°C in oven for 4 hours
No. of determinations : 2 for vertical and horizontal displacements

Hardness

4. ASTM C661 : 2015 Standard Test Method For Indentation Hardness Of Elastomeric-Type Sealants By Means Of A Durometer

Test Conditions:

a) 23°C and 50% relative humidity for 7 days
b) 38°C and 95% relative humidity for 7 days
c) 23°C and 50% relative humidity for 7 days
No. of determinations : 2, 3 points per test piece

Tack-Free Time

5. ASTM C679 : 2015 Standard Test Method For Tack-Free Time Of Elastomeric Sealants

No. of determinations : 2

Cyclic Adhesion & Cohesion

6. Adopted ASTM C719 : 2014 Standard Test Method For Adhesion And Cohesion Of Elastomeric Joint Sealants Under Cyclic Movement (Hockman Cycle)

Test Conditions:

a) 23°C and 50% relative humidity for 7 days
b) 38°C and 95% relative humidity for 7 days
c) 23°C and 50% relative humidity for 7 days
d) Immersion in distilled water at 23°C for 7 days
e) Drying in oven at 70°C for 7 days
Test temperature : Room temperature
No. of determinations : 3 for class 25

Effects Of Heat Ageing

7. ASTM C1246 : 2017 Standard Test Method For Effects Of Heat Ageing On Weight Loss, Cracking, And Chalking Of Elastomeric Sealants After Cure

Test Conditions:

a) 23°C and 50% relative humidity for 28 days
b) 70°C for 21 days
No. of determinations : 3, 1 as control

Test Report No. 7191168129-MEC17-ED
dated 5 Oct 2017



PSB Singapore

Effects Of Accelerated Weathering

8. Adopted ASTM C793 : 2005 (2017) Standard Test Method For Effects Of Accelerated Weathering On Elastomeric Joint Sealants

Test cycle : 8 hours UV exposure at 55°C and 4 hours condensation at 45°C
 Lamp designation : Fluorescent UVA 340 mm
 Exposure duration : 250 hours
 No. of determinations : 3 (1 as control)
 Bend test
 Apparatus : Steel mandrel
 Test condition : -26°C for 24 hours
 No. of determinations : 3

Adhesion-In-Peel

9. ASTM C794 : 2015a Standard Test Method For Adhesion-In-Peel Of Elastomeric Joint Sealants

Test Conditions:

- a) 23°C and 50% relative humidity for 7 days
 b) 38°C and 95% relative humidity for 7 days
 c) 23°C and 50% relative humidity for 7 days
 d) Immersion in water at 23°C for 7 days
 Crosshead speed : 50.8 mm/min
 No. of determinations : 4

Material Identification/Verification

10. ASTM E1252 : 1998 (2013) e1 Standard Practice For General Techniques For Obtaining Infra-Red Spectra For Qualitative Analysis
 Material Identification/Verification By Fourier Transform Infra-Red Spectrometric Analysis (FTIR)

CONDITIONING:

Unless otherwise specified, all test specimens were tested at 23 ± 2°C and 65 ± 5% relative humidity.

TEST RESULTS:

Test	'Pereseal Polyurethane Sealant'	Sealant - Semi-Precast Construction
1. Staining And Colour Change	No staining and no colour change	No visible staining on white cement mortar base
2. Extrudability	14.8 ml/min	>10 ml/min
3. Rheological (Flow) Properties	Vertical displacement: 0 mm sag Horizontal displacement: No deformation	Vertical displacement <4.8 mm Horizontal displacement : No deformation
4. Indentation Hardness	test piece 1, average : 35.6 test piece 2, average : 36.0 average of 2 test pieces : 35.8	25 to 50 (traffic) 15 to 50 (non-traffic)

Test Report No. 7191168129-MEC17-ED
dated 5 Oct 2017



PSB Singapore

TEST RESULTS:

Test	'Pereseal Polyurethane Sealant'	Sealant - Semi-Precast Construction
5. Tack-Free Time	No transfer of test specimens to the polyethylene film	No transfer of sealant to PE film
6. Adhesion & Cohesion Under Cyclic Movement, class 25	No loss in bond	Total loss in bond and adhesion <9 cm ²
7. Effects Of Heat Ageing On Weight Loss, Cracking And Chalking, average	1.1% No cracking and chalking	Loss in weight <7% No cracking and chalking
8. Effects Of Accelerated Weathering	No cracks after UV exposure and bend test	No cracks
9. Adhesion-In-Peel, average	60.7 N cohesive failure within the sealant and no adhesive bond loss between sealant and substrate for each test piece	Peel strength >22.2 N Bond loss <25%
10. Material Identification/Verification By FTIR	Polyurethane-based material (Figure 1)	PU/Silicone

REMARKS:

The test conditions for staining and colour change tests and effects of accelerated weathering test were adopted from ASTM G154 : 2006 Standard Practice For Operating Fluorescent Light Apparatus For UV Exposure Of Non-Metallic Materials.


Eddie Suwand

Eddie Suwand
 Testing Officer
 Senior Associate Engineer

Fabien Tan

Fabien Tan
 Engineer
 Real Estate & Infrastructure
 Mechanical Centre

Photo 1 : 'Pereseal Polyurethane Sealant'

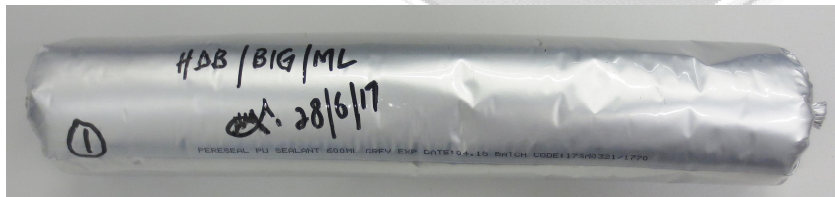


Test Report No. 7191168129-MEC17-ED
dated 5 Oct 2017



PSB Singapore

Figure 1 : IR spectrum of 'Pereseal Polyurethane Sealant'

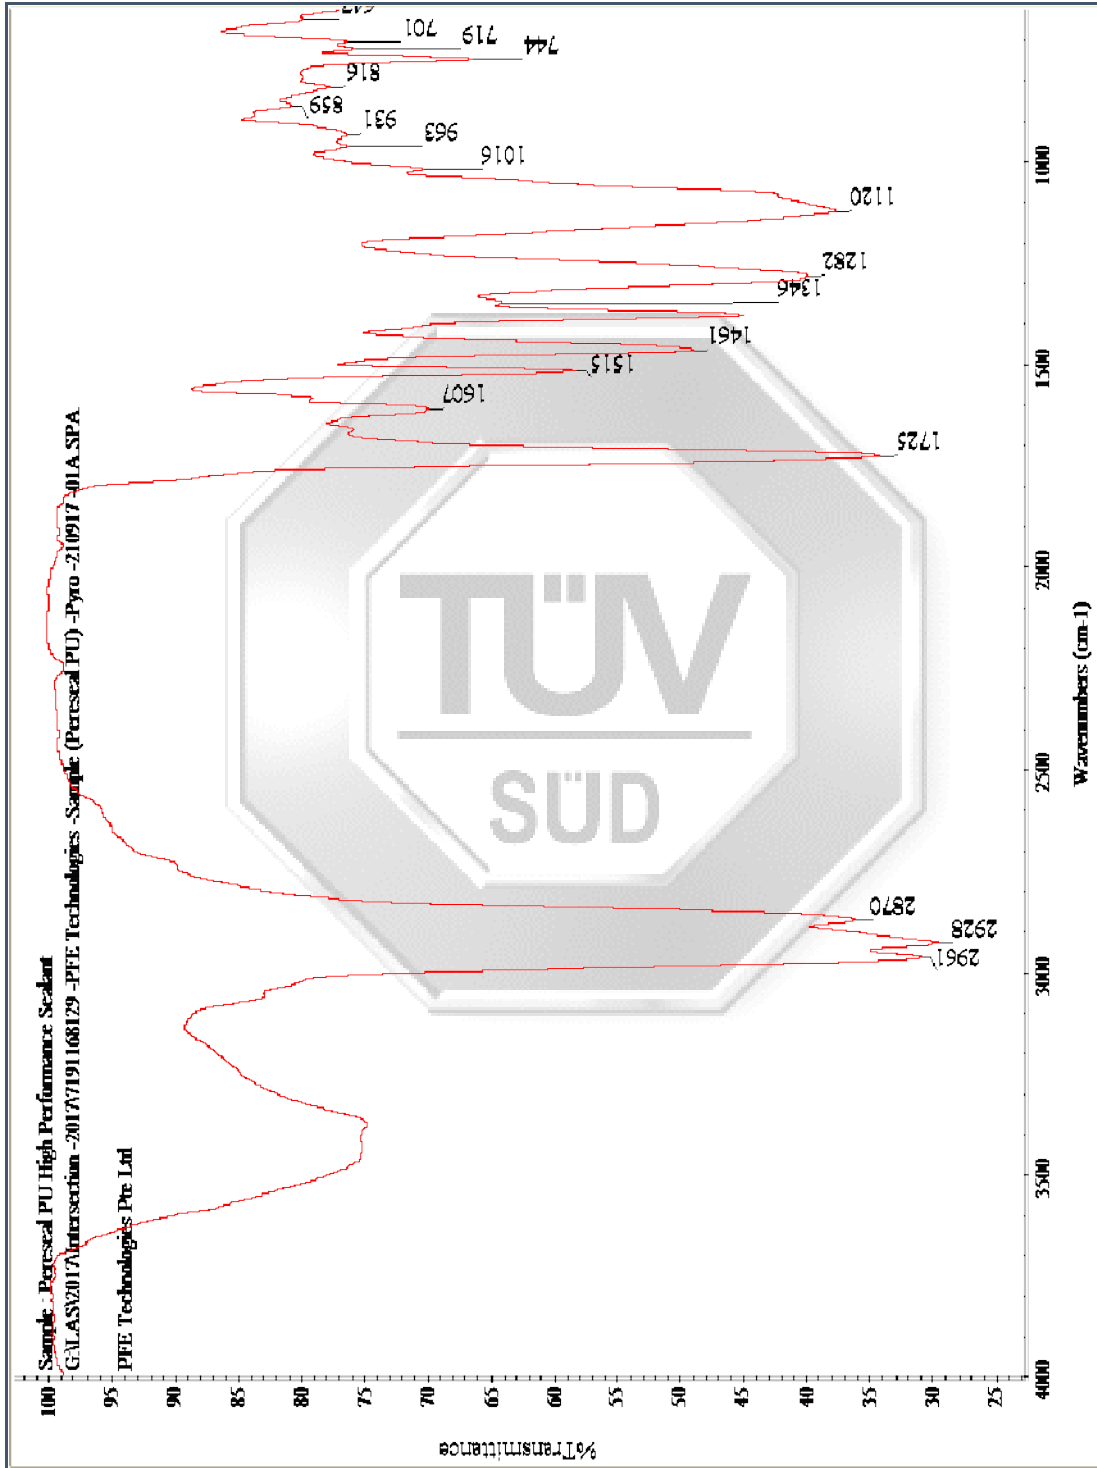

Test Report No. 7191168129-MEC17-ED
dated 5 Oct 2017



PSB Singapore

Please note that this Report is issued under the following terms :

1. This report applies to the sample of the specific product/equipment given at the time of its testing/calibration. The results are not used to indicate or imply that they are applicable to other similar items. In addition, such results must not be used to indicate or imply that TÜV SÜD PSB approves, recommends or endorses the manufacturer, supplier or user of such product/equipment, or that TÜV SÜD PSB in any way "guarantees" the later performance of the product/equipment. Unless otherwise stated in this report, no tests were conducted to determine long term effects of using the specific product/equipment.
2. The sample/s mentioned in this report is/are submitted/supplied/manufactured by the Client. TÜV SÜD PSB therefore assumes no responsibility for the accuracy of information on the brand name, model number, origin of manufacture, consignment or any information supplied.
3. Nothing in this report shall be interpreted to mean that TÜV SÜD PSB has verified or ascertained any endorsement or marks from any other testing authority or bodies that may be found on that sample.
4. This report shall not be reproduced wholly or in parts and no reference shall be made by the Client to TÜV SÜD PSB or to the report or results furnished by TÜV SÜD PSB in any advertisements or sales promotion.
5. Unless otherwise stated, the tests were carried out in TÜV SÜD PSB Pte Ltd, No.1 Science Park Drive Singapore 118221.

July 2011

